

08/799913

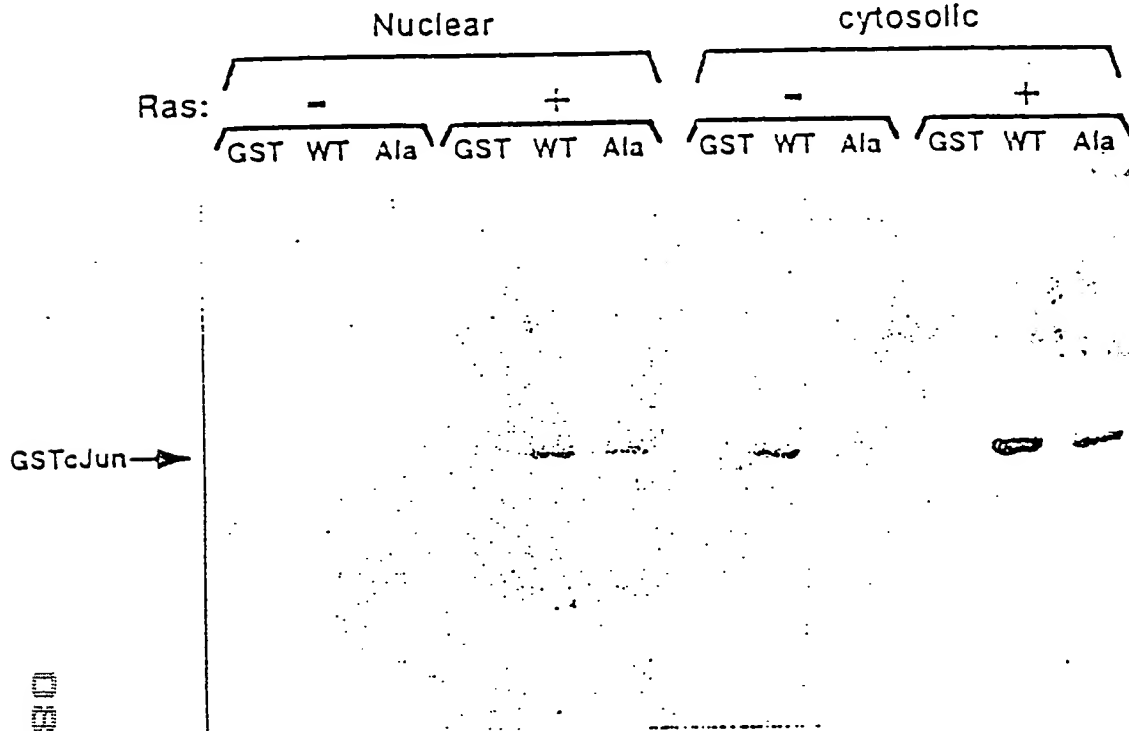


FIGURE 1

40

U8/8 7/9, 9/3

B

Treatment:	-	UV	UV	UV	UV	TPA	TPA
Substrate:	WT	WT	WT	GST	Ala	WT	WT
Time:	0	5	30	30	30	5	30

Treatment:	-	TPA	TPA	TPA	TPA
Substrate:	WT	WT	WT	GST	Ala
Time:	0	10	30	30	30

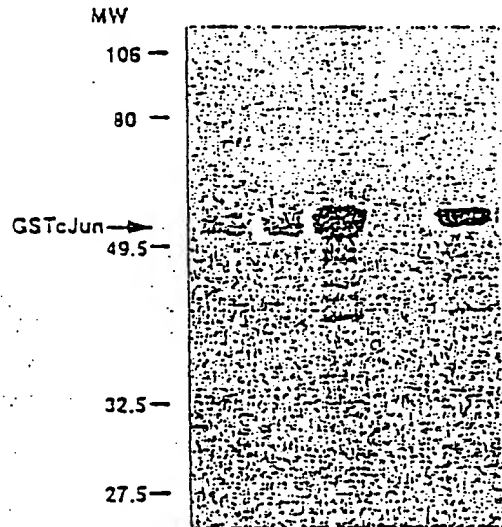
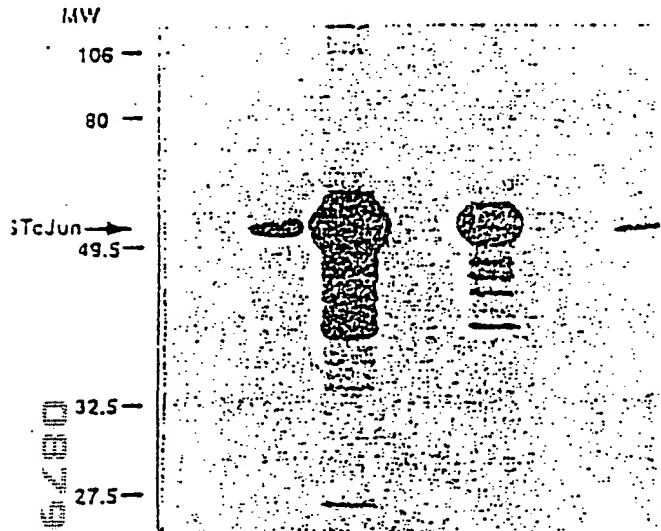


FIGURE 2

08/799,913

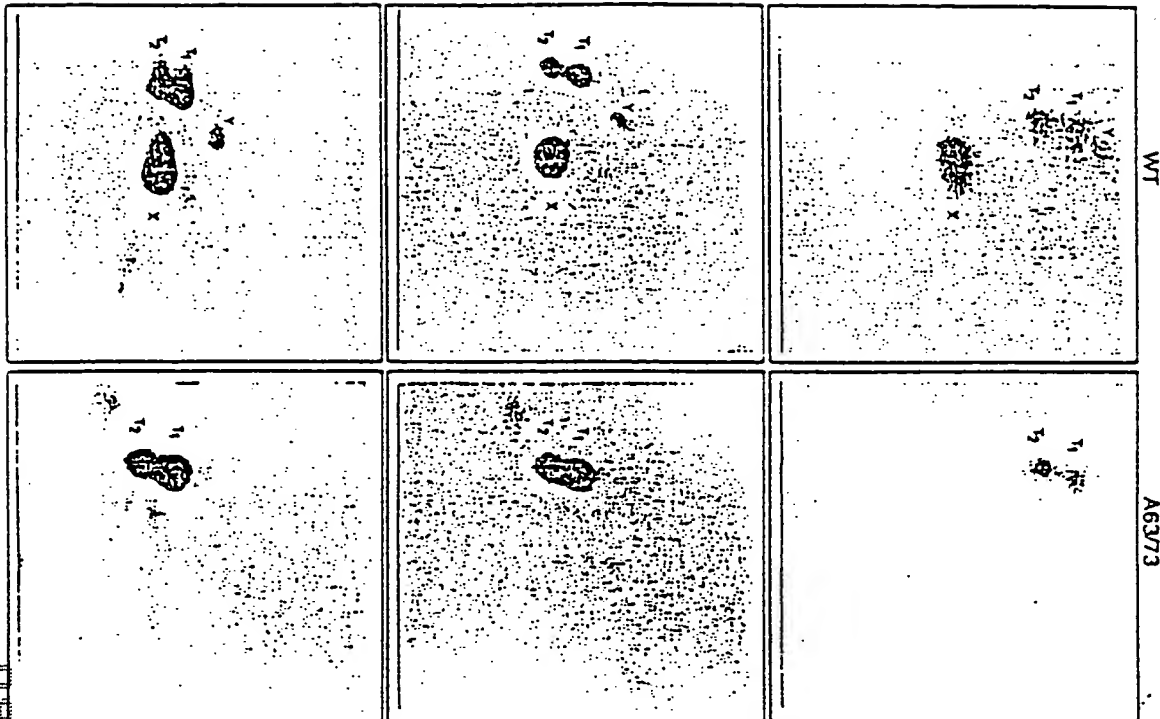


FIGURE 3A

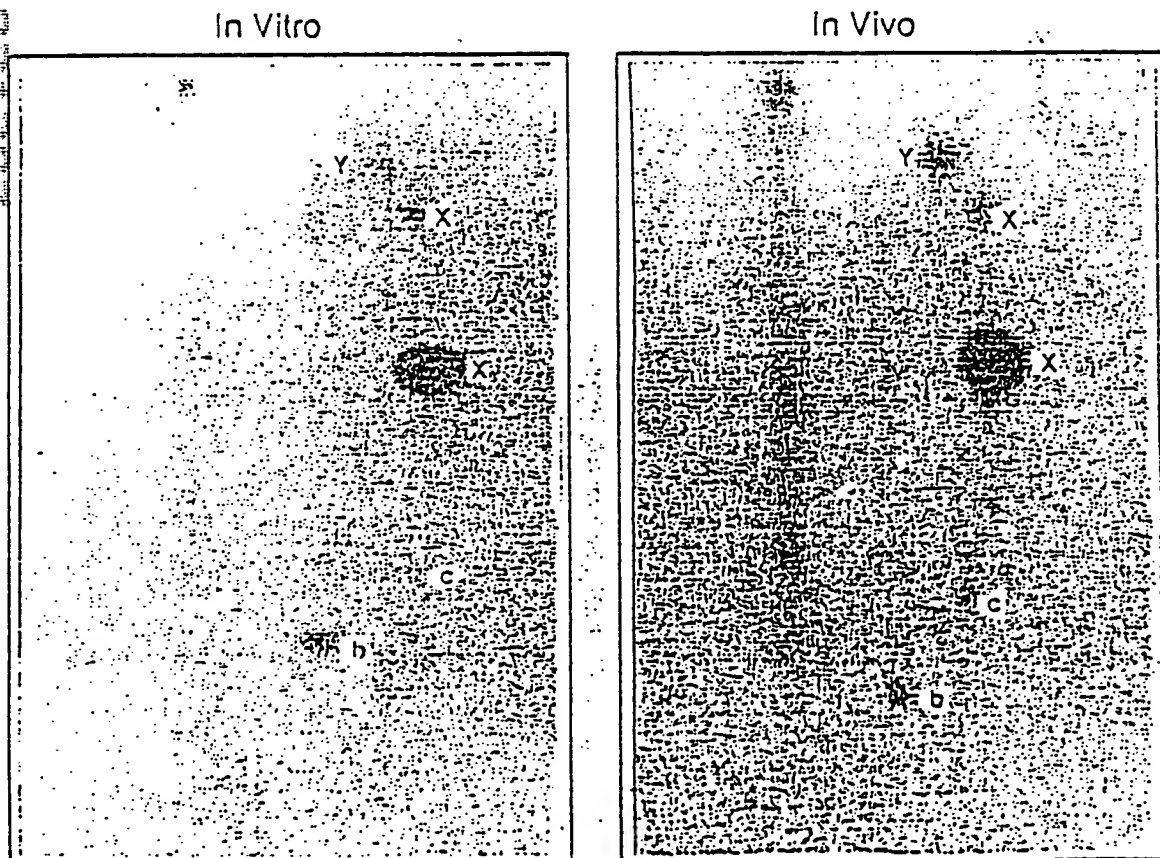


FIGURE 3B

08/799,913, 021397

08/799,913

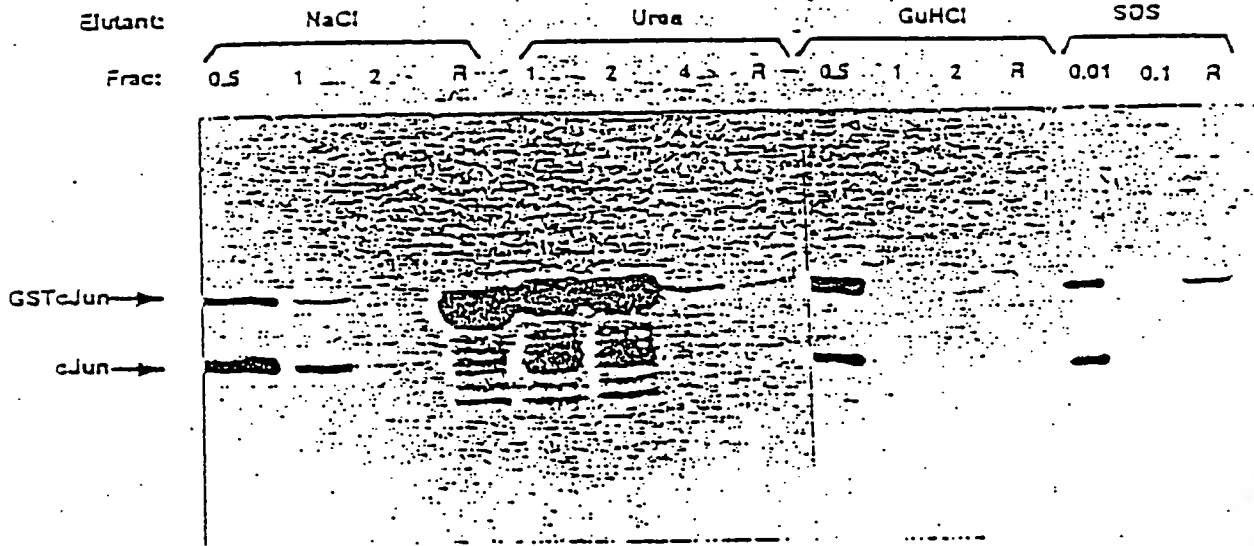


FIGURE 4A

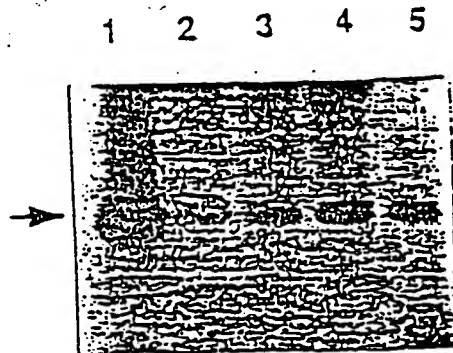


FIGURE 4B

08/799,913

08/799, 9/13

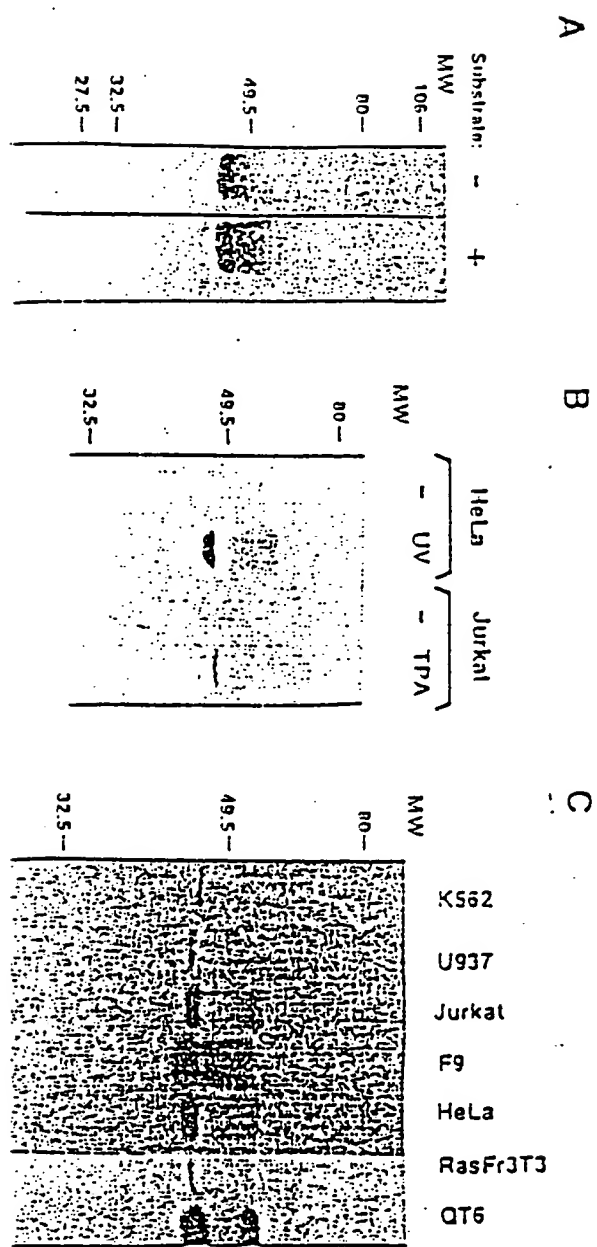


FIGURE 5

0879913.021397

08/799, 913

In Gel

³²P-Immobilized
Substrate

C. ³²P-Exogenous
Substrate


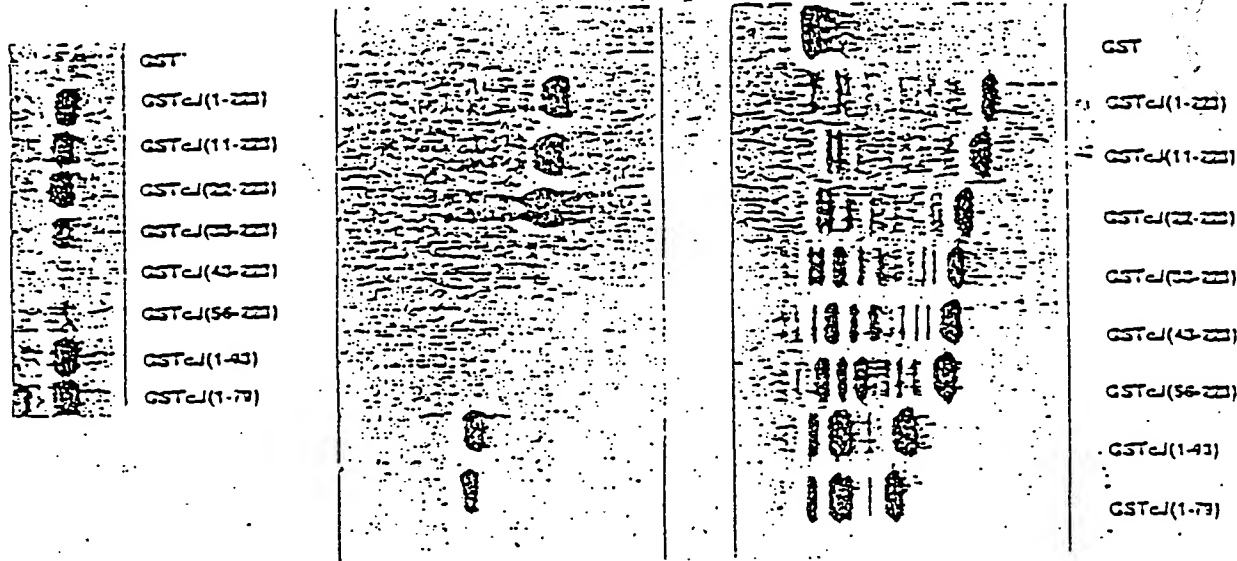


FIGURE 6


0879913-021397

08/799,913

08799913-021397
ET 666480

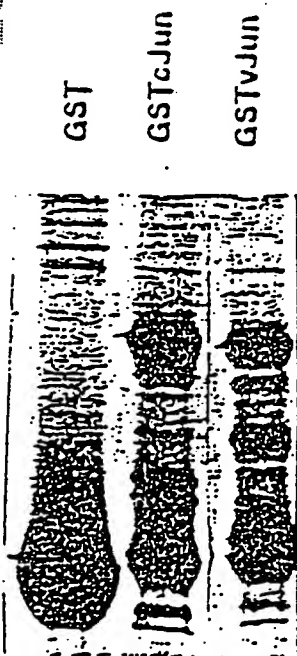

00

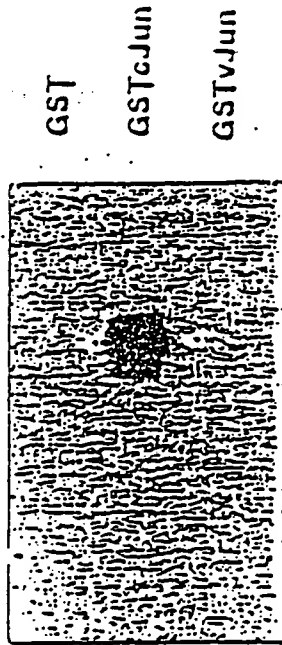

0



FIGURE 7

08/799, 213


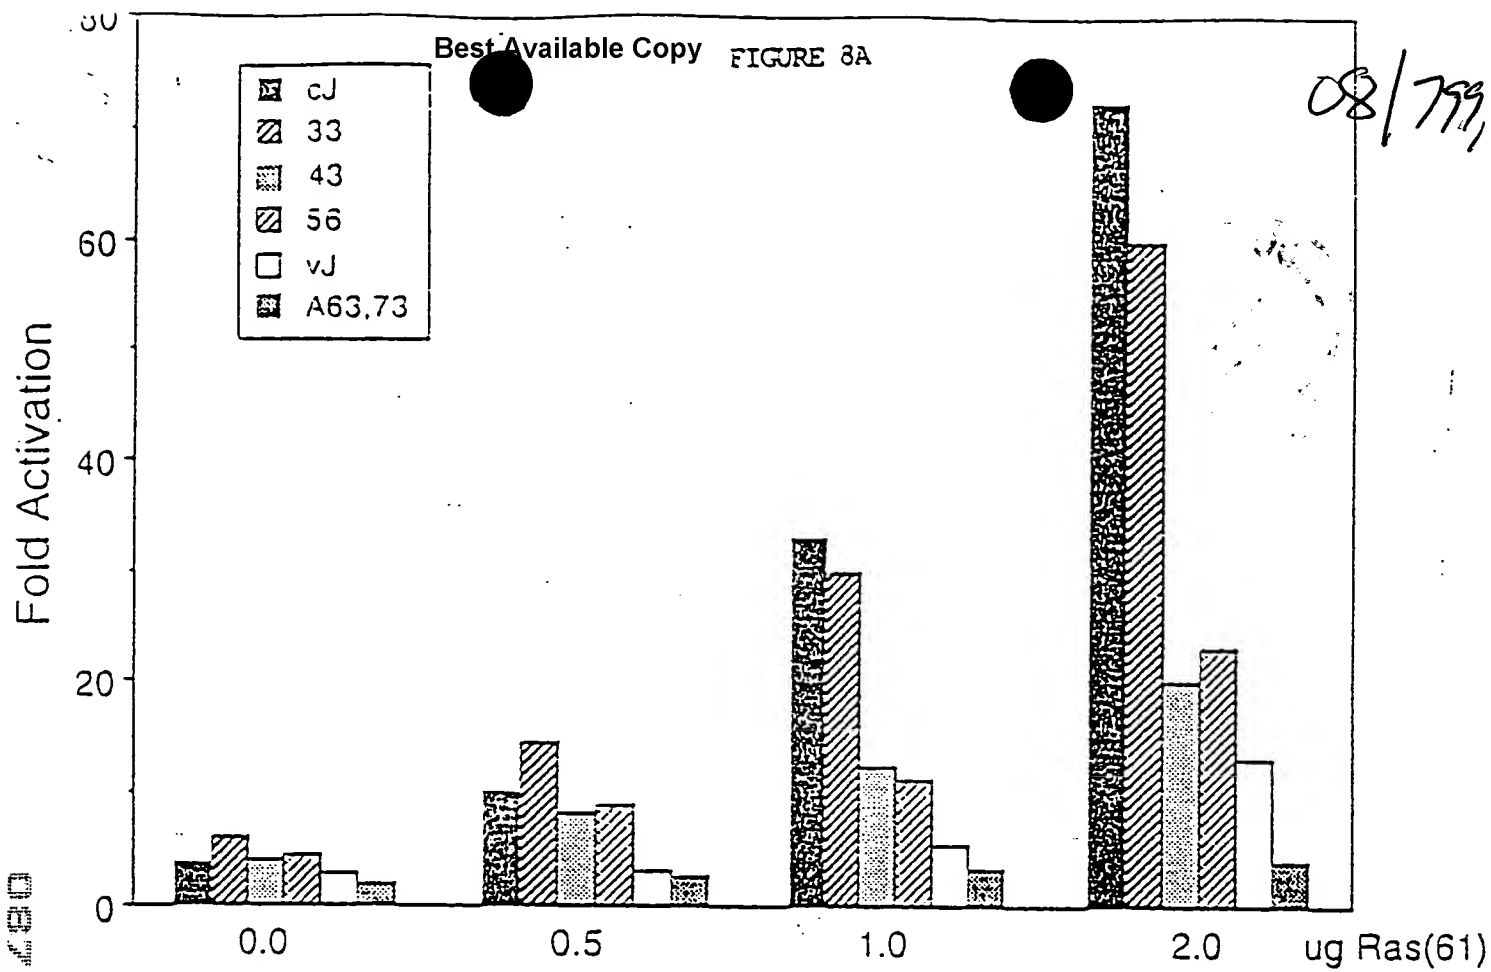


FIGURE 8B

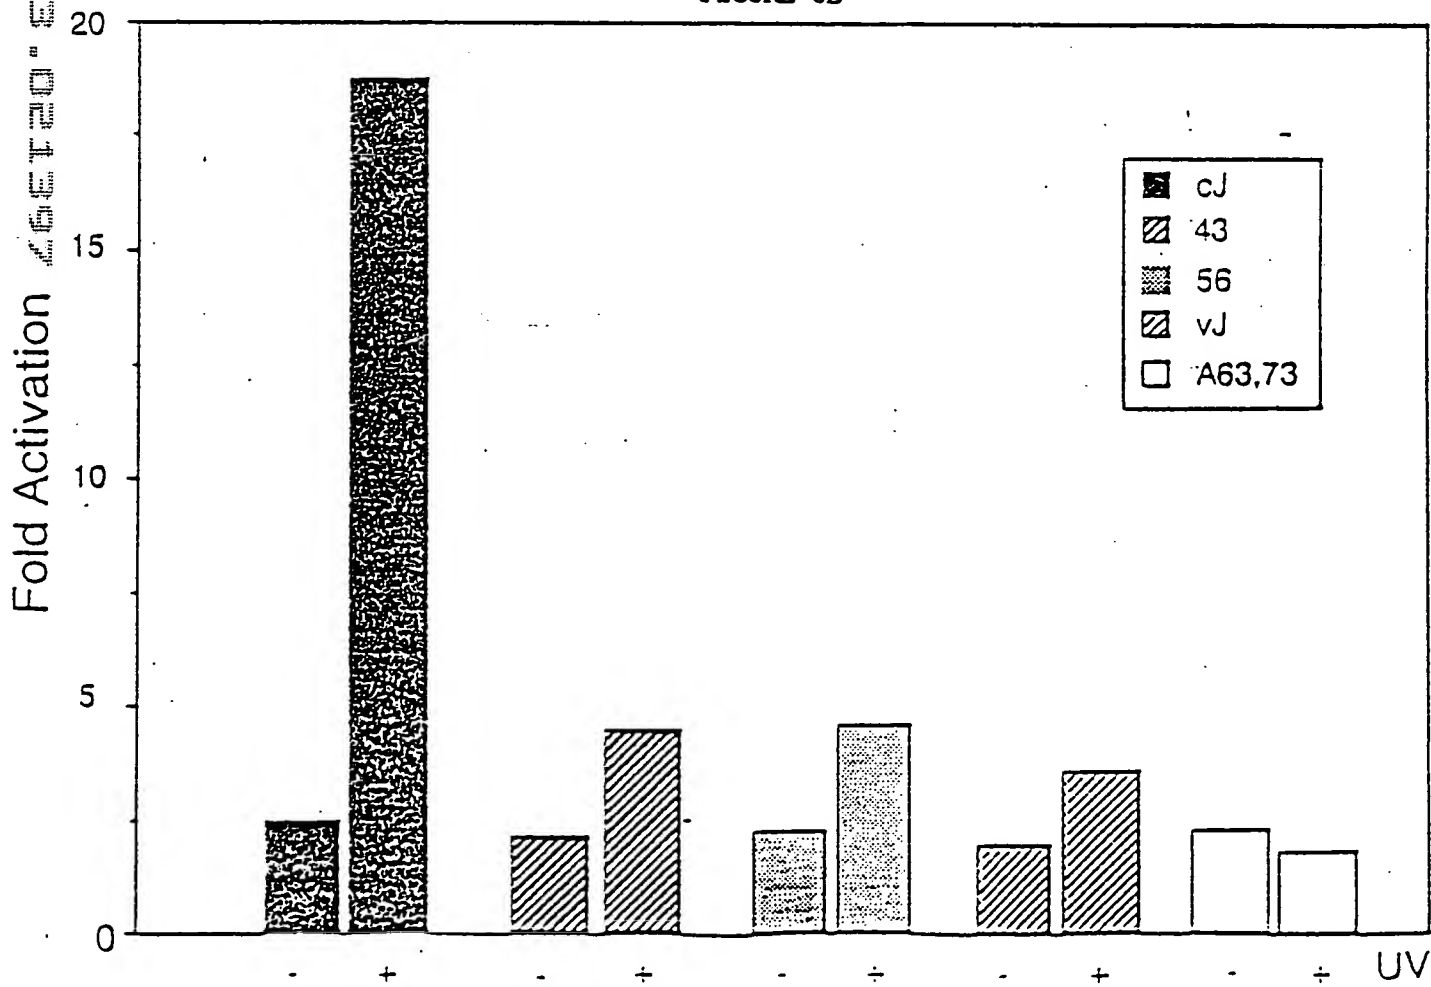

08/799,913

FIGURE 9A


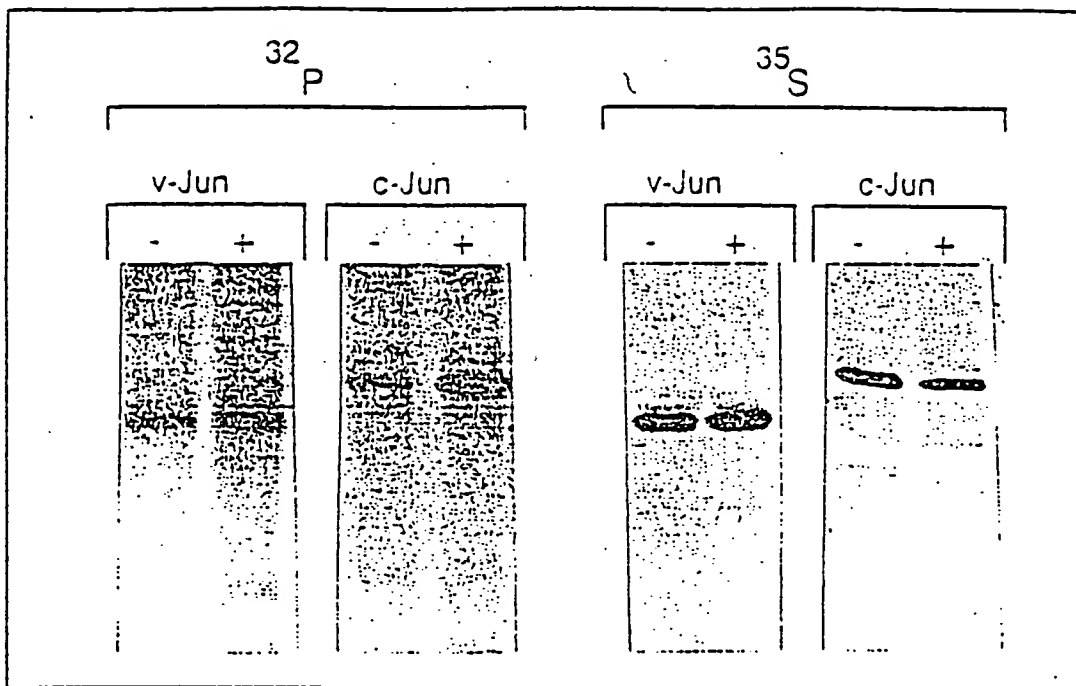


FIGURE 9B

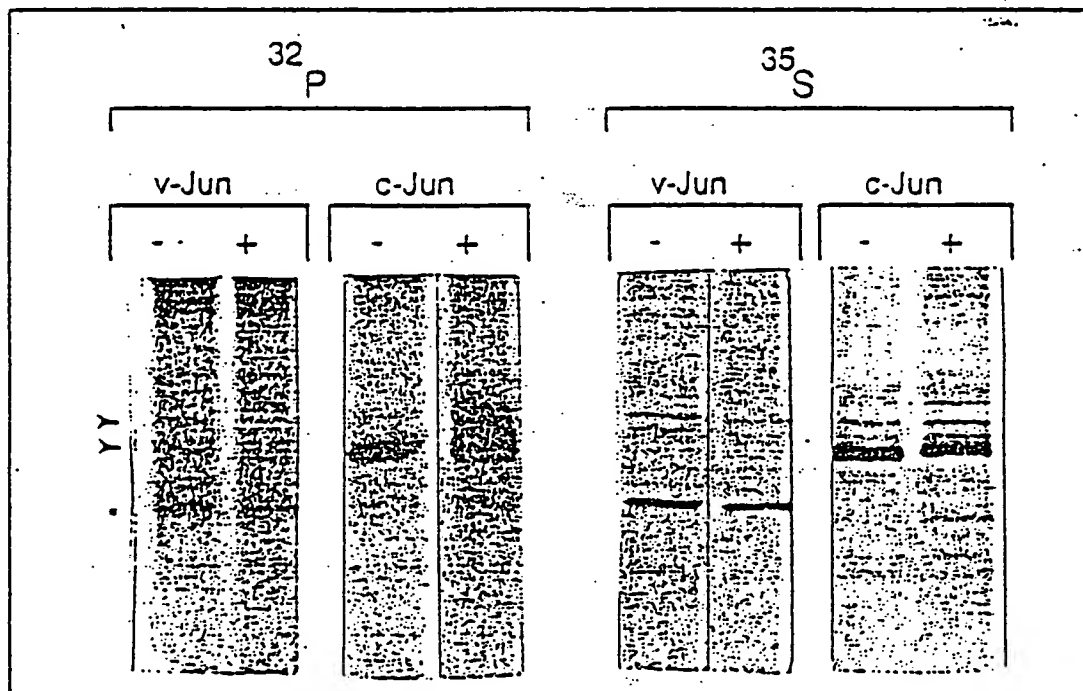

08/799,913-021397

Ud 79, 9/3

CONFIDENTIAL

08/799,9/13

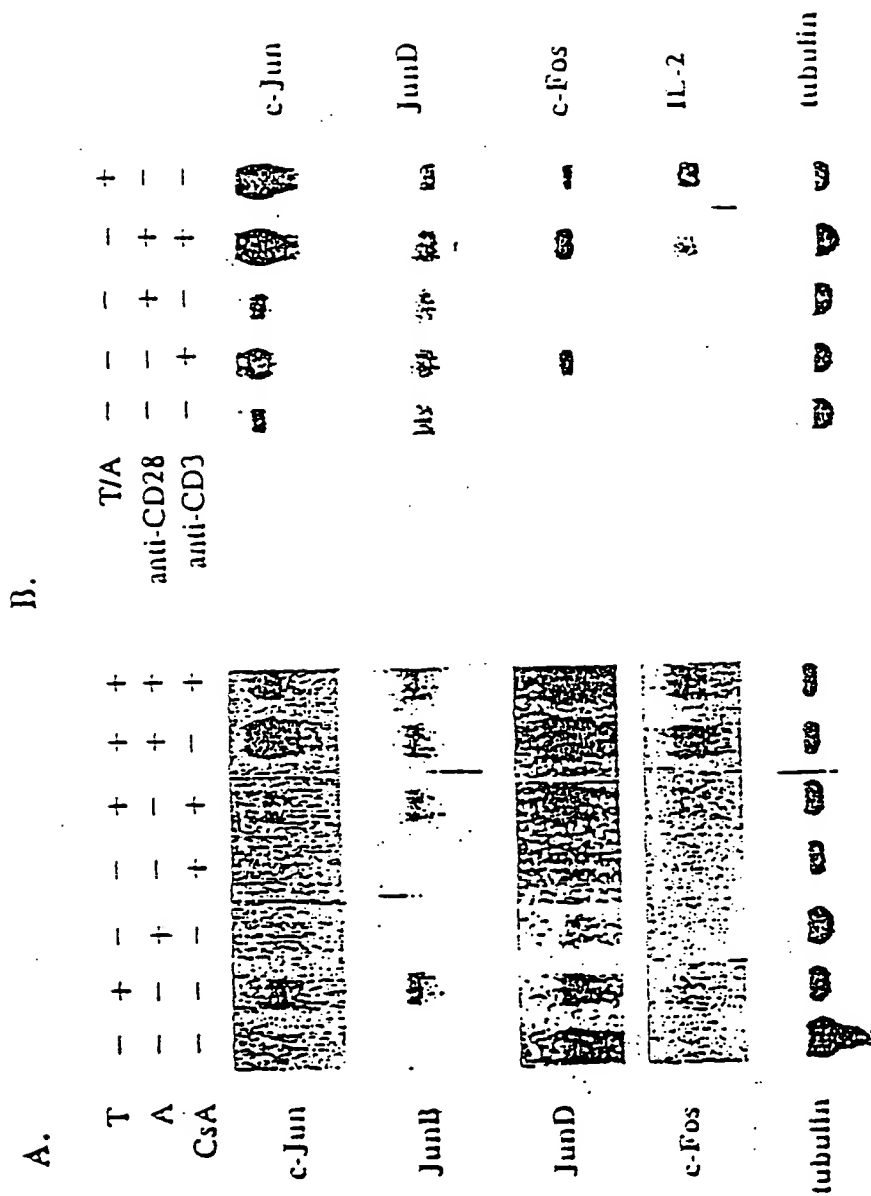


FIGURE 11

08/799,913

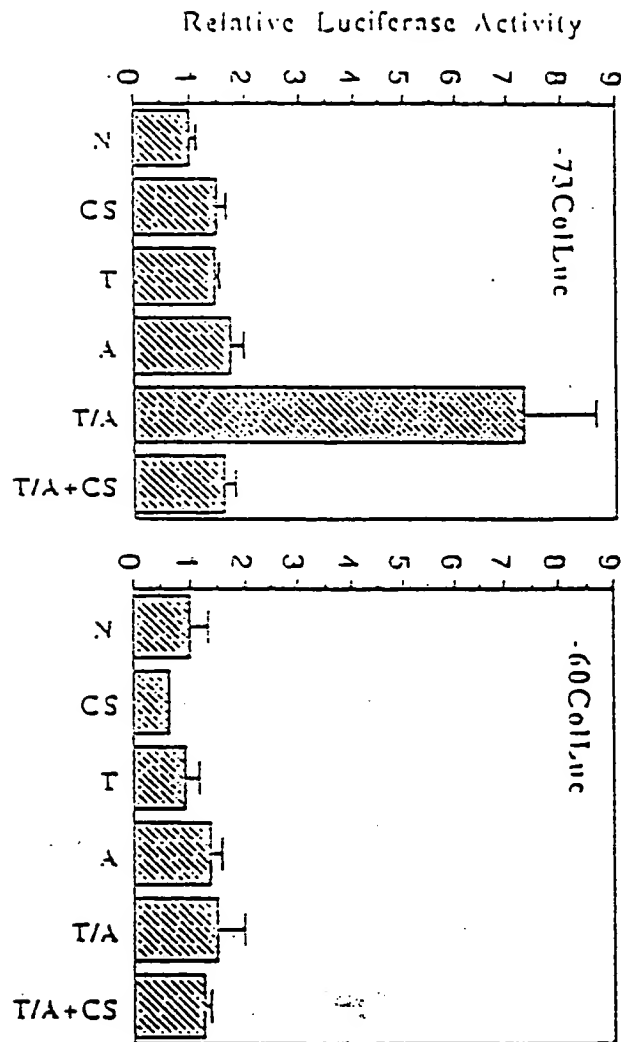


FIGURE 11c

08799913-021397

08/79, 9/3

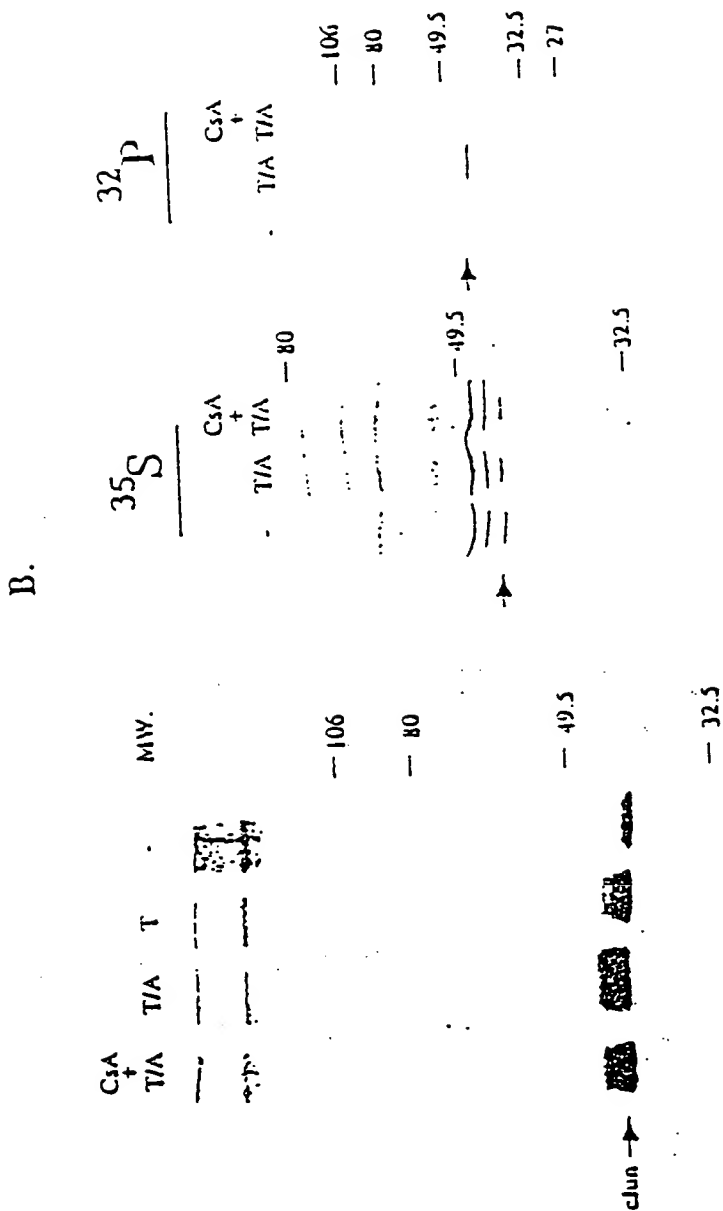


FIGURE 12

08/799,913



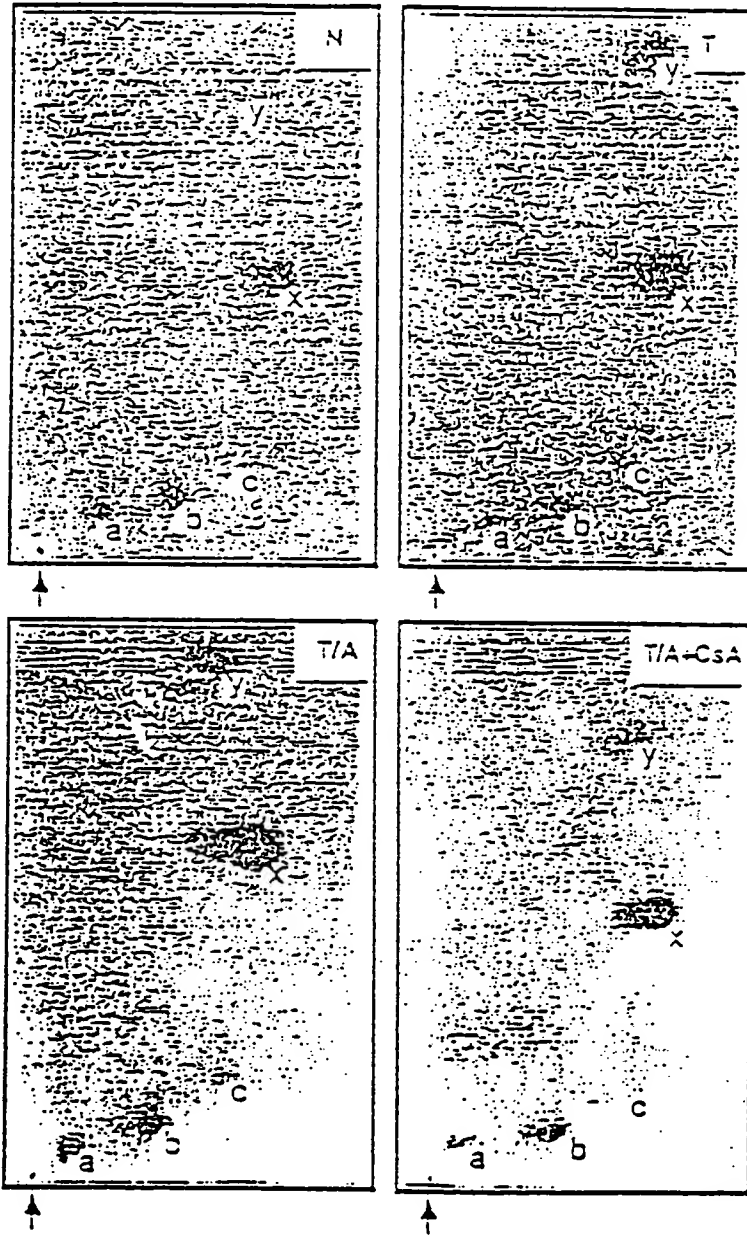


FIGURE 12c

08799913-021397

08/799, 913

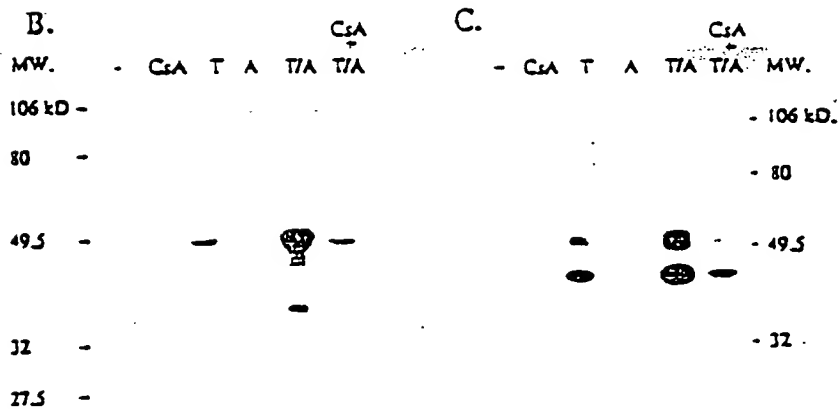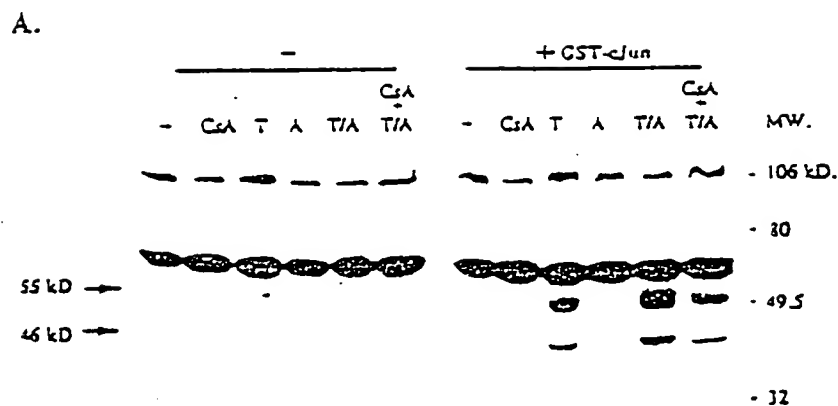

-FIGURE 13

08799913-021397

08/79,913


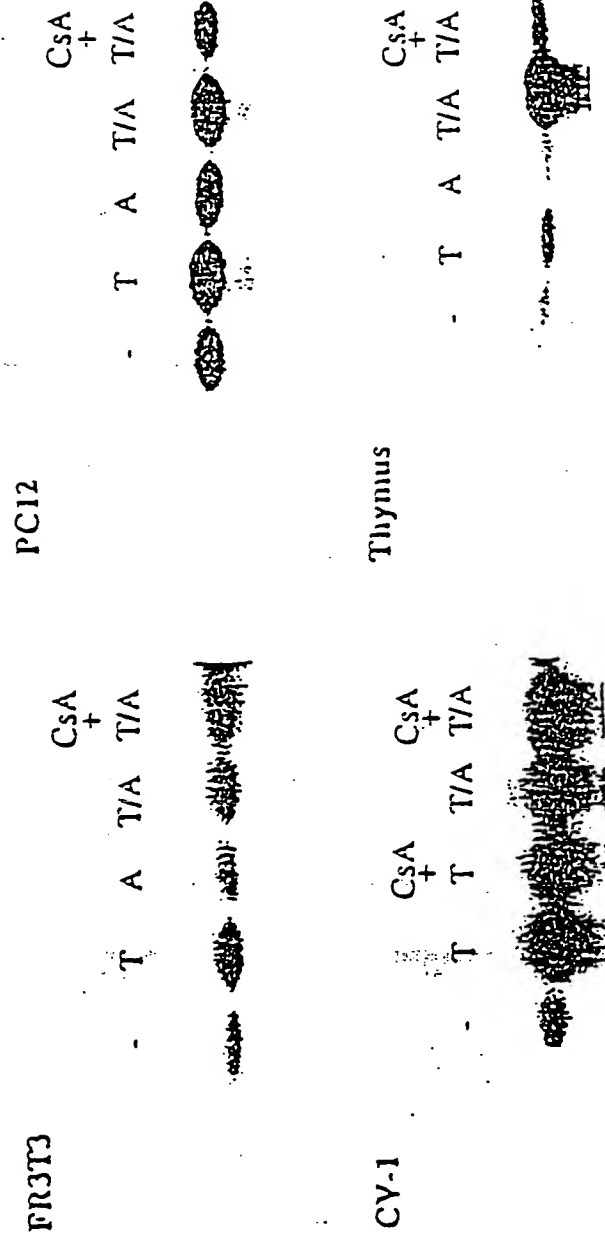



FIGURE 14

08/799, 913

46ET20" ET666480

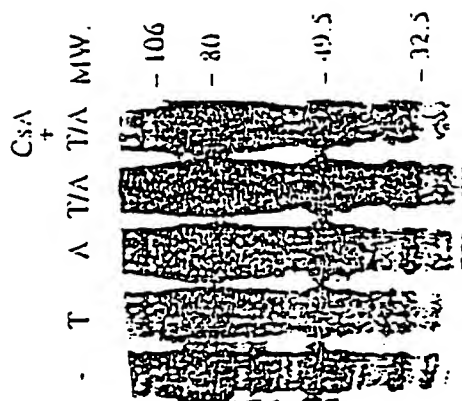

C.

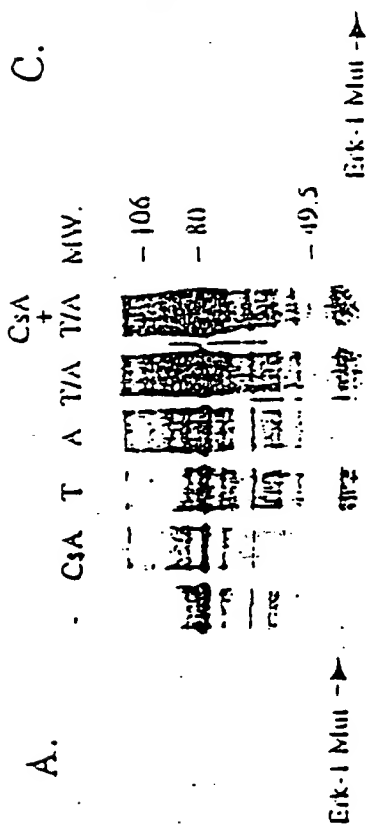

A.

Erk-1 Mut →

D. MDP →


B. MDP →

FIGURE 15

08/797, 413


A.

CsA	+	-	-	-	-
anti-CD28	+	+	-	+	-
anti-CD3	+	+	+	-	-



B.

CsA	-	-	-	-	+
anti-CD28	-	-	+	+	+
anti-CD3	-	+	-	+	+

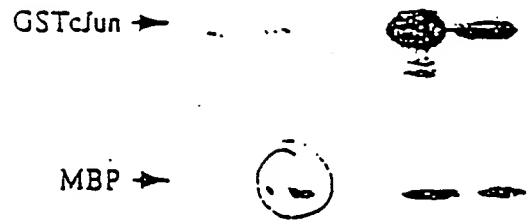

C.

	1	2	3	4	5	6	7	8	9	10	11
CsA	-	-	-	-	-	-	+	-	+	-	+
anti-CD28	-	-	-	-	+	-	-	-	+	-	+
anti-CD3	-	-	-	+	-	-	-	+	+	-	-
A	-	-	+	-	-	+	+	-	-	-	-
T	-	+	-	-	-	+	+	+	+	+	+

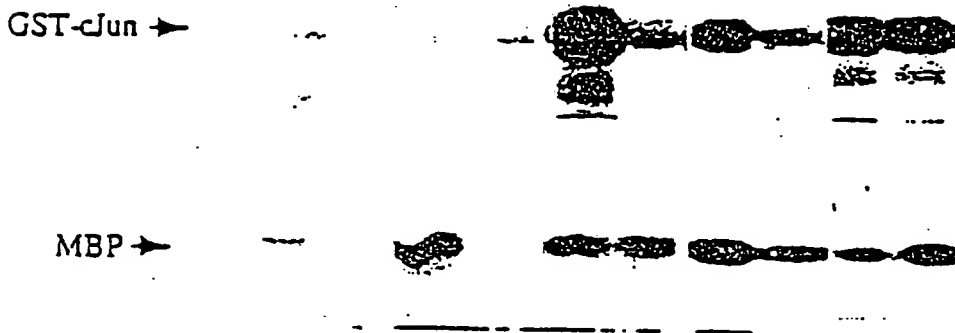


FIGURE 16

08799913-024397

08/799913

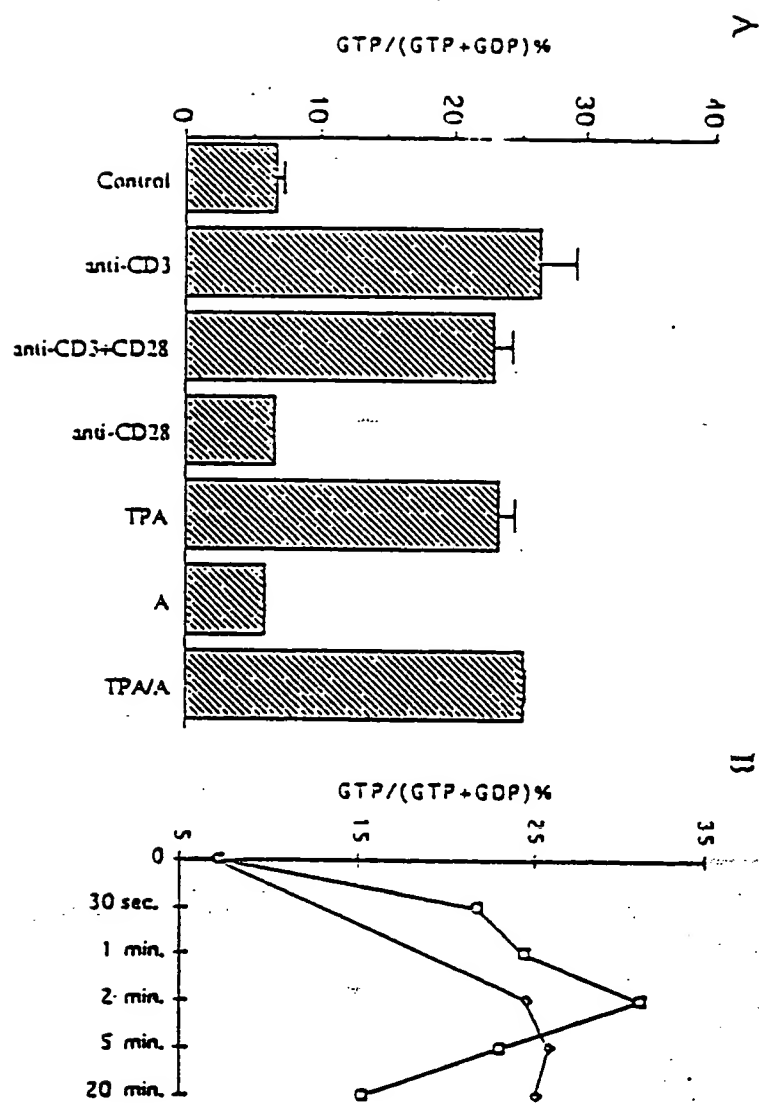


FIGURE 17

CANCELLED

08799913-021397

**This Page is Inserted by IFW Indexing and Scanning
Operations and is not part of the Official Record**

BEST AVAILABLE IMAGES

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images include but are not limited to the items checked:

- ☒ **BLACK BORDERS**
- ☒ **IMAGE CUT OFF AT TOP, BOTTOM OR SIDES**
- ☒ **FADED TEXT OR DRAWING**
- ☐ **BLURRED OR ILLEGIBLE TEXT OR DRAWING**
- ☐ **SKEWED/SLANTED IMAGES**
- ☐ **COLOR OR BLACK AND WHITE PHOTOGRAPHS**
- ☐ **GRAY SCALE DOCUMENTS**
- ☒ **LINES OR MARKS ON ORIGINAL DOCUMENT**
- ☐ **REFERENCE(S) OR EXHIBIT(S) SUBMITTED ARE POOR QUALITY**
- ☐ **OTHER:**

IMAGES ARE BEST AVAILABLE COPY.

As rescanning these documents will not correct the image problems checked, please do not report these problems to the IFW Image Problem Mailbox.